

1 BILL NO. S-90-07 -05

2 SPECIAL ORDINANCE NO. D-189-90

3 AN ORDINANCE certifying and approving  
4 the need for the services of a  
5 consultant to design the necessary  
6 modifications and replacements for  
7 pump station controls and telemetry  
8 for the City of Fort Wayne Three  
9 Rivers Filtration Plant.

10 WHEREAS, the City of Fort Wayne through its Board of  
11 Public Works and Safety desires to have professional  
12 engineering services furnish the design and construction  
13 engineering for improving existing instrumentation,  
14 monitoring, control and telemetry equipment in the City's  
15 water system pumping stations and water storage facilities,  
16 and also for improving the telemetry and directly associated  
17 monitoring and control equipment at the Three Rivers  
18 Filtration Plant;

19 WHEREAS, the City of Fort Wayne does not have the  
20 capability of performing this work with in-house forces; and

21 WHEREAS, the Board of Public Works and Safety believes  
22 that there is a need to employ a consultant to perform this  
23 service; and

24 WHEREAS, it is anticipated that the amount to be paid  
25 to said consultant, on an annual basis, will be in excess of  
26 \$15,000.00.

27 NOW, THEREFORE, BE IT ORDAINED BY THE COMMON COUNCIL OF  
28 THE CITY OF FORT WAYNE, INDIANA:

29 SECTION 1. The Common Council of the City of Fort  
30 Wayne hereby certifies and approves the need for the services  
31 of a consultant to provide professional engineering services  
32 for technical proposals for the necessary design modifications  
and replacements for pump station controls and telemetry for  
the City of Fort Wayne Three Rivers Filtration Plant.



Read the first time in full and on motion by Schmidt, seconded by Salvino, and duly adopted, read the second time by title and referred to the Committee on Finance (and the City Plan Commission for recommendation) and Public Hearing to be held after due legal notice, at the Council Conference Room 128, City-County Building, Fort Wayne, Indiana, on \_\_\_\_\_, the \_\_\_\_\_, day of \_\_\_\_\_, 19\_\_\_\_, at \_\_\_\_\_ o'clock \_\_\_\_\_ M., E.S.T.

DATED: 7-10-90

Sandra E. Kennedy  
SANDRA E. KENNEDY, CITY CLERK

Read the third time in full and on motion by Schmidt, seconded by Salvino, and duly adopted, placed on its passage. PASSED ~~LOST~~ by the following vote:

	AYES	NAYS	ABSTAINED	ABSENT
TOTAL VOTES	<u>6</u>	<u>1</u>		<u>2</u>
BRADBURY	<u>✓</u>			
BURNS		<u>✓</u>		
EDMONDS	<u>✓</u>			
GIAQUINTA	<u>✓</u>			
HENRY				<u>✓</u>
LONG				<u>✓</u>
REDD	<u>✓</u>			
SCHMIDT	<u>✓</u>			
TALARICO	<u>✓</u>			

DATED: 8-14-90

Sandra E. Kennedy  
SANDRA E. KENNEDY, CITY CLERK

Passed and adopted by the Common Council of the City of Fort Wayne, Indiana, as (ANNEXATION) \_\_\_\_\_ (APPROPRIATION) \_\_\_\_\_ (GENERAL) \_\_\_\_\_ (SPECIAL) \_\_\_\_\_ (ZONING MAP) \_\_\_\_\_ ORDINANCE RESOLUTION NO. A-189-90 on the 14th day of August, 1990.

Sandra E. Kennedy ATTEST  
SANDRA E. KENNEDY, CITY CLERK

SEAL  
Charles S. Reed  
PRESIDING OFFICER

Presented by me to the Mayor of the City of Fort Wayne, Indiana, on the 16th day of August, 1990 at the hour of 11:30 o'clock A. M., E.S.T.

Sandra E. Kennedy  
SANDRA E. KENNEDY, CITY CLERK

Approved and signed by me this 20th day of August, 1990, at the hour of 9:45 o'clock A. M., E.S.T.


PAUL HELMKE  
PAUL HELMKE, MAYOR



CONTROL SYSTEM CONFIGURATION  
Figure 1.4-2

RTS - REPORT/TREND STATION  
DES - DATA ENTRY STATION  
OS - OPERATING STATION

KEY  
--- FIBER OPTIC  
--- COAXIAL

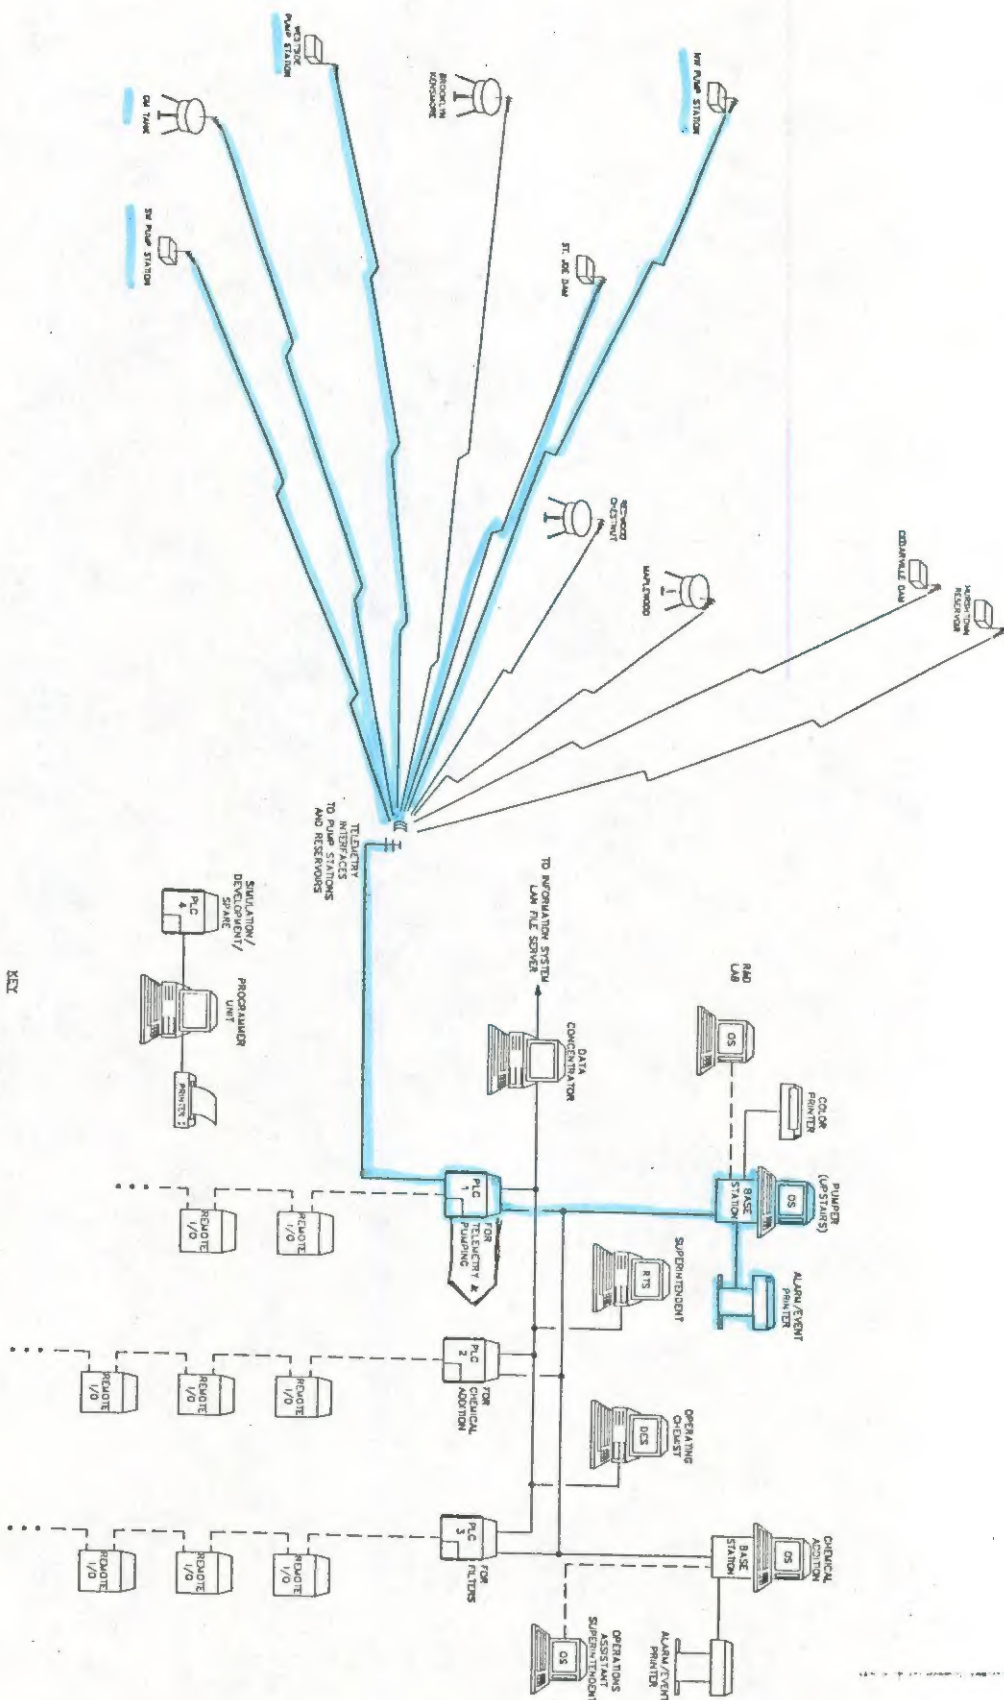

FT. WAYNE THREE RIVERS FILTRATION PLANT

EMA  
SERVICES, INC.  
Engineering & Software • 100-100-100

DIGEST SHEET

TITLE OF ORDINANCE SPECIAL ORDINANCE

DEPARTMENT REQUESTING ORDINANCE BOARD OF PUBLIC WORKS AND SAFETY

SYNOPSIS OF ORDINANCE APPROVES THE NEED FOR A CONSULTANT TO PROVIDE  
THE DESIGN OF NECESSARY MODIFICATIONS AND REPLACEMENTS FOR PUMP  
STATION CONTROLS AND TELEMETRY FOR THE THREE RIVERS FILTRATION PLANT.

*J-50-07-05*

~~EFFECT~~ OF PASSAGE PUMP STATIONS CAN BE UPGRADED AND RELIABILITY

IMPROVED.

EFFECT OF NON-PASSAGE STATIONS WILL CONTINUE TO TRANSMIT ERRONEOUS

READINGS REQUIRING EXTENSIVE MANPOWER TO MANUALLY OPERATE AND REPAIR.

MONEY INVOLVED (DIRECT COSTS, EXPENDITURES, SAVINGS) \_\_\_\_\_

ASSIGNED TO COMMITTEE (PRESIDENT) \_\_\_\_\_



7-20  
2-46  
8/14

BILL NO. S-90-07-05

REPORT OF THE COMMITTEE ON FINANCE

THOMAS C. HENRY, CHAIRMAN  
DONALD J. SCHMIDT, VICE CHAIRMAN  
BRADBURY, BURNS, GiaQUINTA

WE, YOUR COMMITTEE ON FINANCE TO WHOM WAS

REFERRED AN (ORDINANCE) (~~RESOLUTION~~) certifying and approving  
the need for the services of a consultant to design the  
necessary modifications and replacements for pump station  
controls and telemetry for the City of Fort Wayne Three  
Rivers Filtration Plant

HAVE HAD SAID (ORDINANCE) (~~RESOLUTION~~) UNDER CONSIDERATION  
AND BEG LEAVE TO REPORT BACK TO THE COMMON COUNCIL THAT SAID  
(ORDINANCE) (~~RESOLUTION~~)

DO PASS

DO NOT PASS

ABSTAIN

NO REC

[Signature]  
Janet H. Bradbury  
Clitus R. Edwards  
Walter R. Rapp

DATED: 8-14-90.

Sandra E. Kennedy  
City Clerk